


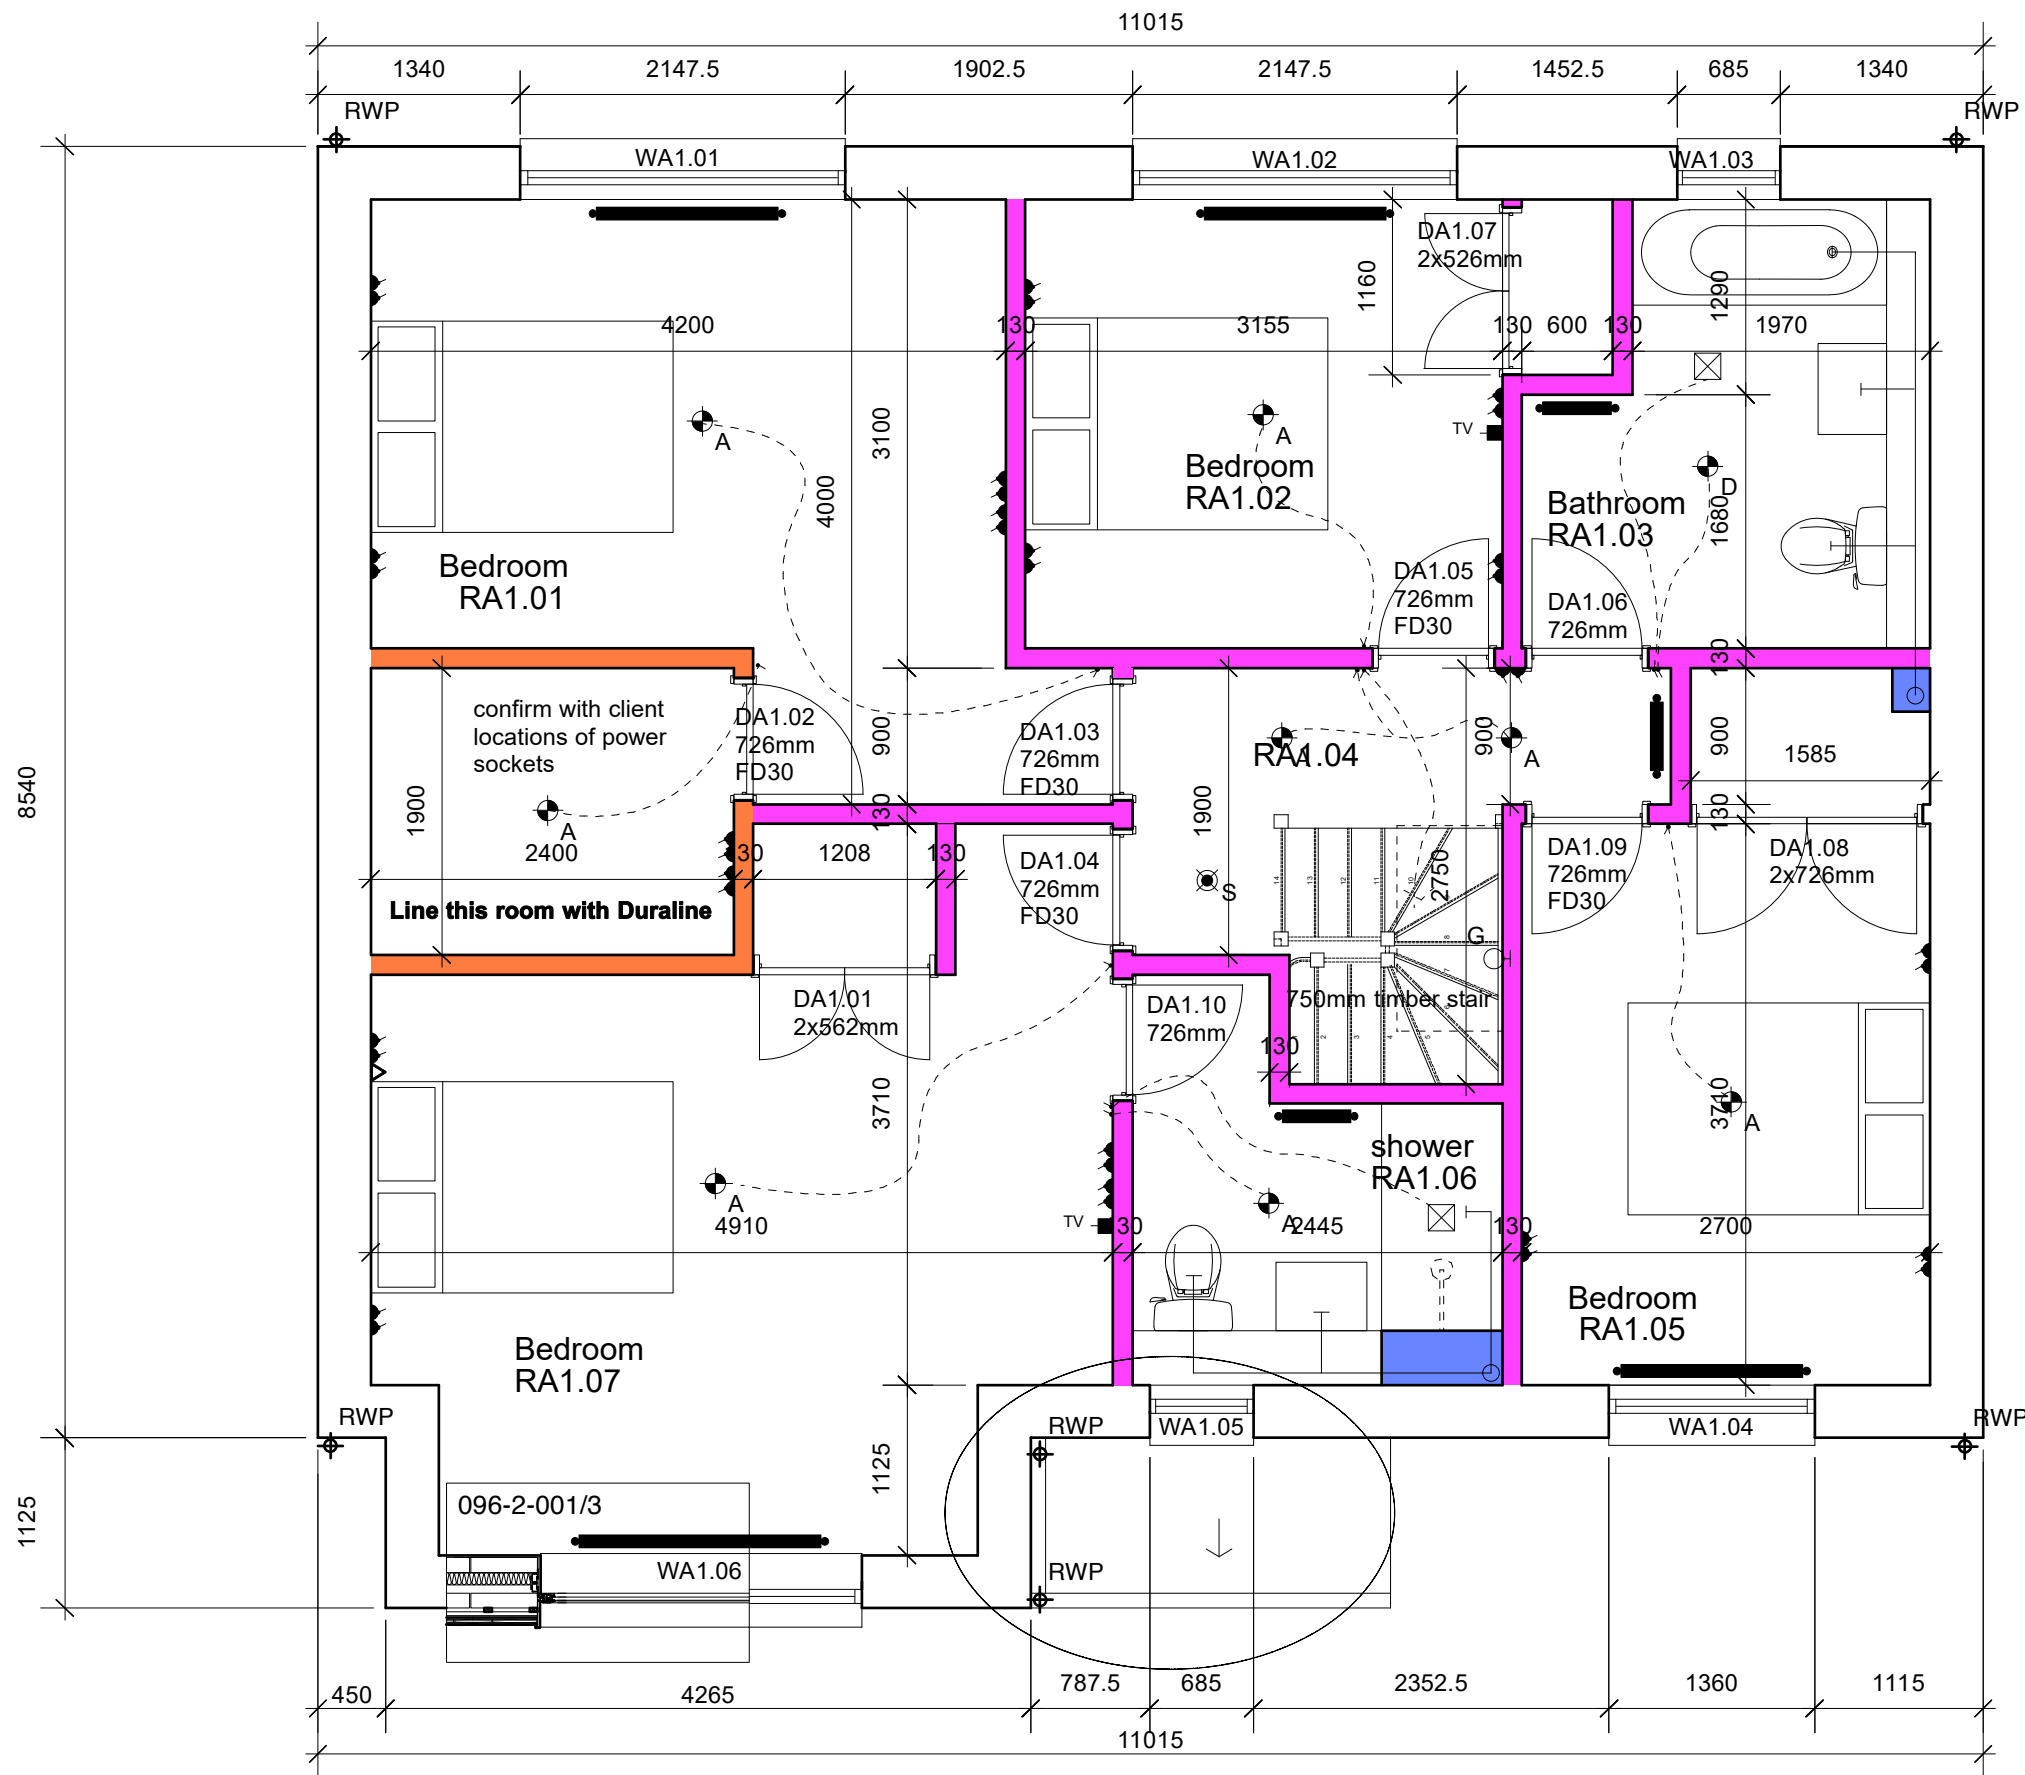


- KEY
- small power supply - general
- single light switch
- luminaire - pendant
- recessed LED spot
- pelmet light
- Standards 16W 2D fitting (enclosed)
- fluorescent fitting
- external light fitting
- wall light
- smoke detector
- smoke detector
- radiator
- extractor/exhaust
- TV / Aerial point
- Telephone
- Meters
- Distribution Board

KEY WALL CONSTRUCTION

- Type A = 100mm block, 15mm plaster both sides
- Type B = 30min. fire rated partition 100x 50 sw studs, 25mm insulation with 12.5 wallboards and skim both sides.
- Type C = Non-fire rated partition 75 x 50 sw studs, 25mm insulation with 12.5 wallboards and skim both sides
- Type D = Plasterboard / skim on sw stud and insulation full fill around pipe & mdf access panel at low level.

|    |                 |                                    |
|----|-----------------|------------------------------------|
| C1 | 28 January 2011 | Construction issue                 |
| C2 | 09 March 2011   | Bathroom window dimensions amended |
| C3 | 30 March 2011   | Stair setting out amended          |
| C4 | 10 May 2011     | Bedroom layouts amended            |
| C5 | 25 May 2011     | Canopy amended                     |

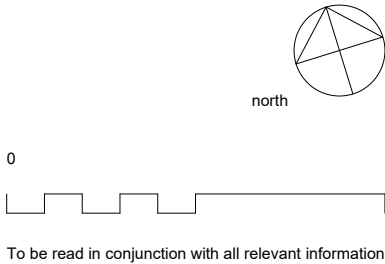

|         |                                |      |    |
|---------|--------------------------------|------|----|
| project | Willow Cottages                |      |    |
| for     |                                |      |    |
| title   | First floor proposed (House A) |      |    |
| status  | Stage K                        |      |    |
| scale   | 1:50                           | size | A3 |
| rev.    | C6                             |      |    |